

Figure 11.1 Built up air handling unit showing the various sections or "modules" that can comprise such a unit.

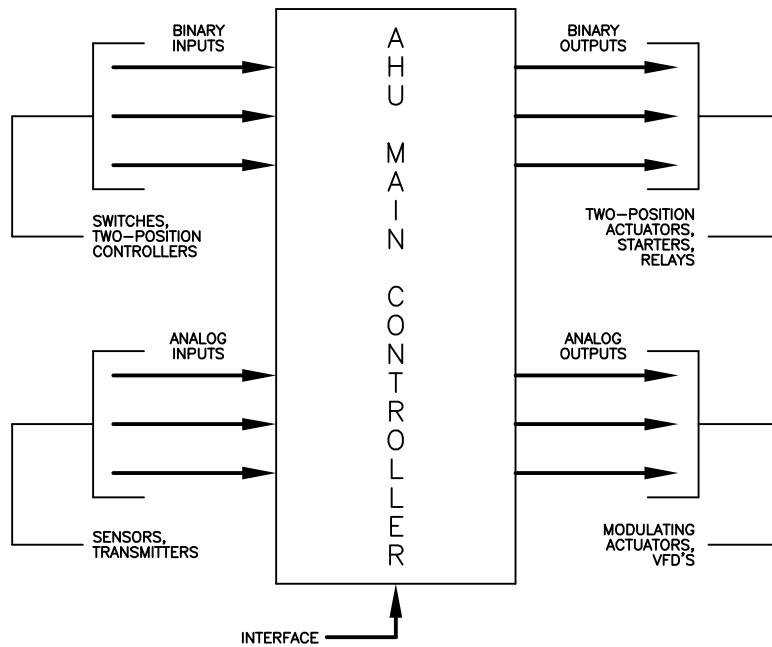


Figure 11.2 Equipment level digital controller, serving as the main controller for a built up air handler. The main controller processes all inputs and coordinates all output values in alliance with the Sequence of Operation. Interface to the controller is required for initial programming, commissioning, and adjustment of operating parameters (as necessary).